
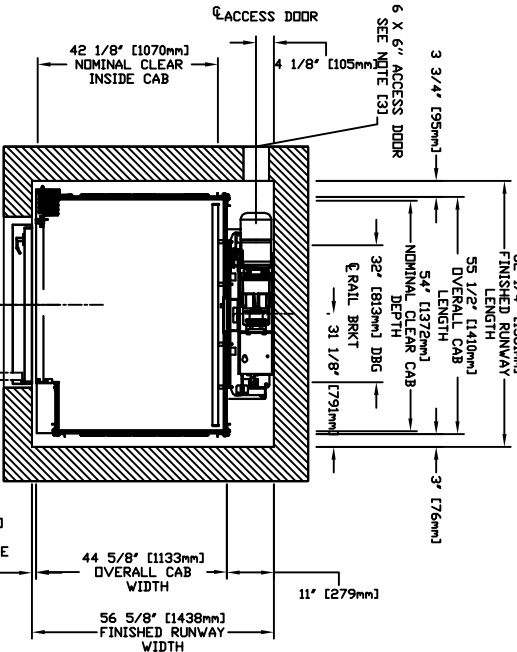
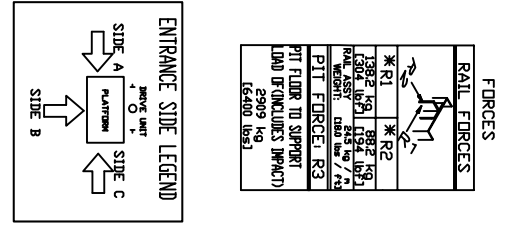
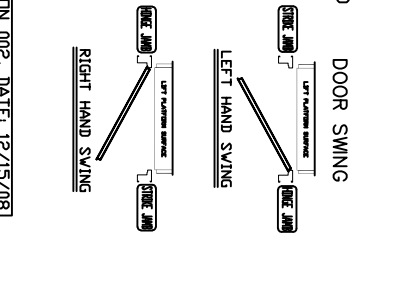


| | |
|-------------------------------|--|
| FINAL RAIL BRACKET RB3 | BELOW THE MOTOR CONSULT YOUR REPRESENTATIVE FOR LOCATION |
| INTERMEDIATE RAIL BRACKET RB2 | 32" (813mm) INTERVALS AFTER 2ND BOTTOM BRACKET |
| BOTTOM RAIL BRACKET RB1 | 44" (1118mm) ABOVE PIT FLOOR |

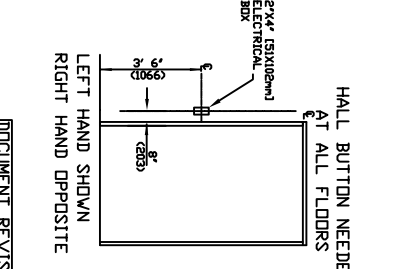

CHARACTERISTICS

GENERAL

APPLIED CODE: _____

CAPACITY: _____ (750, 1000 LBS)

NOMINAL SPEED: _____ 40 FPM

TRAVEL: _____

PIT DEPTH: _____ (MIN. 6')

CAR DETAILS

CAB PANEL SELECTION: _____ (SEE CHART)

CEILING SELECTION: _____ (MATCH)

CAB FLOORING: _____ (PLY, FINISH)

FINISHED FLOOR THICKNESS: _____ (1/8 to 3/4')

CAB HEIGHT: _____ (80, 96')

CAB OPERATION: _____ (AUTO)

GATE TYPE: _____ (FOLD, CROLL, CAB STILL)

LOCKS/CALL STATIONS/TRAVEL/DOORS (BY OTHERS)

TRAVEL: _____

ENTRANCE SIDE: _____

DOOR SWING: _____

LOCK TYPE: _____

AUTO DOOR OP: _____

STANDARD OPTIONS PROVIDED:

BUTTON MARKING: _____ NUMERIC (1 to 4)

HALL CALL KEYS: _____ NO

MATCH CALL FINISH: _____ NO

HALL CALL SHAPE: _____ RECTANGULAR

PREWIRE PACKAGE: _____ NO

CONTROLLER LOCATION: _____ EXTERNAL

DISCONNECT (2): _____ NO

BUFFER SPRING: _____ NO

TEMP. RUN BUTTON: _____ NO

EXTRA CABLE (EMOTED): _____ NO

WALL FASTENERS: _____ LAG

PROVISIONS BY OTHERS

***HOISTWAY CONSTRUCTION SITE CLEARANCE**

- HOISTWAY CONSTRUCTION AND PIT BY OTHERS DUE TO LIMITED SPACE WITHIN THE HOISTWAY IT IS ESSENTIAL THAT THE PIT IS LEVEL AND WALLS ARE SQUARE AND PLUMB THROUGHOUT THE HOISTWAY. THE HOISTWAY FRAMING MUST BE WITHIN 1/8" (3.2mm) OF PLUMB AND SQUARE FROM TOP TO BOTTOM FOR PROPER OPERATION OF THE ELEVATOR THROUGHOUT THE HOISTWAY.
- DISTANCE BETWEEN THE HOISTWAY SIDE OF THE LANDING DOOR AND THE CAR DOOR MUST BE AT LEAST 36" (914mm) CLEARANCE. THE HOISTWAY SIDE OF THE DOOR MUST BE AT LEAST 36" (914mm) CLEARANCE FROM THE CAR DOOR. THE HOISTWAY SIDE OF THE DOOR MUST BE AT LEAST 36" (914mm) CLEARANCE FROM THE CAR DOOR. THE HOISTWAY SIDE OF THE DOOR MUST BE AT LEAST 36" (914mm) CLEARANCE FROM THE CAR DOOR.
- HOISTWAY MUST HAVE A MINIMUM 152 mm x 152 mm (6" x 6") LOCKABLE ACCESS HATCH PROVIDED BY SAVARIA CONCORD, LOCATED AT THE TOP OF THE HOISTWAY. THE HATCH MUST BE AN ANTI-VIBRATION TYPE WHICH PROVIDES ACCESS TO THE ELEVATOR DRIVE ASSEMBLY. AN ANTI-VIBRATION TYPE WHICH PROVIDES ACCESS TO THE ELEVATOR DRIVE ASSEMBLY. AN ANTI-VIBRATION TYPE WHICH PROVIDES ACCESS TO THE ELEVATOR DRIVE ASSEMBLY.
- THE PIT FLOOR SHALL BE CONSTRUCTED TO WITHSTAND AN IMPACT LOAD OF 900 KG (640 LBS). REF. CSA B44 SECTION 21.1 (ASME/ANSI A17.1, SECTION 106.3) TO THE DEFORMATION OF THE FLOOR DECK. VARIING AND DISTORTIONS NOT RELIED FOR COMPLIING WITH LOCAL CODES.
- HOISTWAY CONSTRUCTION REQUIREMENTS MAY VARY FROM REGION TO REGION. DIMENSIONS GIVEN ARE MANUFACTURERS RECOMMENDED CLEARANCES. THEY REFLECT CONSIDERABLE ACCESS CLEARANCES. CONSULT LOCAL AUTHORITY TO ASSURE COMPLIANCE WITH REGIONAL AND LOCAL CODES.

DIMENSIONS WARNING

CONTRACTOR/CUSTOMER TO VERIFY ALL DIMENSIONS AND REPORT ANY DISCREPANCIES TO OUR OFFICE IMMEDIATELY.

***STRUCTURAL**

- A LADDER BEARING WALL IS REQUIRED TO SUSTAIN RAIL REACTIONS AS SPECIFIED IN KEY TO RAIL REACTIONS ON DRAWING. BUILDING CONTRACTOR TO CONTACT STRUCTURAL ENGINEER TO DETERMINE IF SUPPORTING WALL WILL SUSTAIN RAIL REACTIONS FOR COMPLIING WITH LOCAL CODES.
- STABLE LINTELS MUST BE PROVIDED BY OWNER/VALENT.
- DOOR FRAMES ARE NOT DESIGNED TO SUPPORT OVERHEAD/VALENT LOADS.
- ALL FULL HEIGHT DOORS MUST BE ALLOWED THROUGH THE DOOR CENTRELINE SHOWN ON PLAN. ALL FULL HEIGHT DOORS MUST BE ALLOWED THROUGH THE DOOR CENTRELINE SHOWN ON PLAN. ALL FULL HEIGHT DOORS MUST BE ALLOWED THROUGH THE DOOR CENTRELINE SHOWN ON PLAN.
- DOOR HANDLE AND LATCH SET REQUIRED FOR ALL FULL SIZE DOORS.
- SEE INSTALLATION MANUAL FOR DETAILS ON THE INTERLOCKS. INTERLOCKS ARE REQUIRED FOR ALL FULL SIZE DOORS.

***ELECTRICAL**

- THE ELEVATOR CONTROLLER IS 620 mm (24.4") WIDE X 984 mm (39.1") HIGH X 170 mm (6.7") DEEP. THE CONTROLLER IS PROVIDED BY SAVARIA CONCORD AND IS EITHER:
 - A. ATTACHED TO THE RAIL WALL INSIDE THE HOISTWAY BETWEEN THE PIT RAILS WITH 8" (203mm) REMOTE LOCATION EXTERNAL TO HOISTWAY THAT MEETS PROPER STRUCTURAL WALL TO SUPPORT THE CONTROLLER ON ALL 4 CORNERS HOLDS POSITION ARE = 597 mm (23.5") WIDE BY 546 mm (21.5") HIGH.
 - B. MOUNTED ON A POWER SUPPLY WITHIN SIGHT OR NEXT TO THE ELEVATOR DRIVE ASSEMBLY. THE CONTROLLER SHALL BE MOUNTED ON A POWER SUPPLY WITHIN SIGHT OR NEXT TO THE ELEVATOR DRIVE ASSEMBLY. THE CONTROLLER SHALL BE MOUNTED ON A POWER SUPPLY WITHIN SIGHT OR NEXT TO THE ELEVATOR DRIVE ASSEMBLY.
- 208/240 VOLT CIRCUIT SHALL ORIGINATE FROM A LOCKABLE 2 POLE FUSED DISCONNECT. THE ELECTRICAL CIRCUIT PROVIDED NEAR THE CONTROLLER SHALL BE 208/240 VOLT, SINGLE PHASE, DEDICATED CIRCUIT WITH NEUTRAL AND GROUND. FUSING MUST BE VOLT FOR 15 AMP SERVICE FOR CAR LIGHT. A LOCKABLE AUXILIARY 240 VOLT AND 15 VOLT DISCONNECT IS REQUIRED INSIDE THE HOISTWAY OR IN SIGHT OF THE CONTROLLER. ALL ELECTRICAL TO DISCONNECTS SHALL BE PROVIDED AND INSTALLED BY OTHERS (CUSTOMER/TECHNICAL SERVICES) AND CONNECTIONS TO HALL-CALLS, PIT SWITCH AND INTERLOCKS ARE PROVIDED.
- THE ILLUMINATION SHALL BE NOT LESS THAN 200 LX (9 FC) AT THE FLOOR LEVEL IN ALL MACHINE ROOMS AND MACHINE SPACES. THE SWITCH FOR THE LIGHT MUST BE WITHIN 1575 mm (51.8") OF THE HOISTWAY ACCESS. THE SWITCH FOR THE LIGHT MUST BE WITHIN 1575 mm (51.8") OF THE HOISTWAY ACCESS. THE SWITCH FOR THE LIGHT MUST BE WITHIN 1575 mm (51.8") OF THE HOISTWAY ACCESS. THE SWITCH FOR THE LIGHT MUST BE WITHIN 1575 mm (51.8") OF THE HOISTWAY ACCESS.
- IF A TELEPHONE CIRCUIT IS REQUIRED OPTION FOR ELEVATOR JACK IS PROVIDED AND INSTALLED BY OTHERS. THIS CIRCUIT SHALL BE TESTED UPON LOCATION NEXT TO INSTALLATION.
- LOCATION / ACCESS - "CONTROLLER ROOM" LOCATED AT THE LOWEST LEVEL ADJACENT TO HOISTWAY, UNLESS SHOWN OTHERWISE ON THE LAYOUT DRAWINGS. FIELD ADJUSTMENT BY INSTALLER MAY BE NECESSARY TO MEET JOB SPEC. A SELF-CLOSING LOCKABLE DOOR WHERE CORE CONSIDERED AS A MACHINE ROOM WHEN APPLICABLE. SLEEVES FOR ELECTRICAL LINES - 18 FROM CONTROLLER ROOM TO ROOM AS REQUIRED. INSTALLATION PER INSTALLERS INSTRUCTIONS.
- ALTHOUGH THE ELEVATOR IS DESIGNED TO MEET CSA B44 (ANSI A17.1), LOCAL AND NATIONAL VARIATIONS ARE RESPONSIBLE FOR COMPLIANCE WITH LOCAL CODES. ALL COMPONENTS WEIGHTS CAN BE FOUND IN THE PLANNING GUIDE.
- NOTE: ALL INFORMATION IS SUBJECT TO CHANGE. PLEASE REFER TO OUR ON-LINE DRAWINGS AT WWW.SAVARIA.COM FOR THE MOST RECENT UPDATES.

RESIDENTIAL ELEVATOR

ECLIPSE MODEL 40X54 TYPE 5

SAVARIA

DATE: _____

PROJECT: _____

LOCATION: _____

CONTROL: _____

SHEET 7

1/1